

# KirbyRib II Wall / Roof Panel Specifications

## PRODUCT NAME

KirbyRib II Panel for roof and wall applications.

## MANUFACTURER

Kirby Building Systems  
P.O. Box 390, 124 Kirby Drive  
Portland, TN 37148  
615 325 4165  
www.kirbybuildingsystems.com

## PRODUCT DESCRIPTION

These wall and roof panels have 1 ¼" ribs on 12" centers for an even, shadowed appearance. They offer 36" width coverage and are reinforced between the ribs for added strength.


Basic Use: A roof and wall covering system for new or retrofit construction.

Materials: KirbyRib II panels are available in 29, 26, and 24 gauge 80,000 psi, 22 gauge 50,000 psi, either G90 zinc coated (galvanized) or AZ50 aluminum zinc alloy coated steel. Prepainted panels have Kynar 500® or Silicone Polyester Cool Paint Finish. An embossed finish is available as an option.

KirbyRib II wall panels are attached to the secondary framing members by self-drilling carbon steel screws, No. 12 x 1 ¼" hex washer head, cadmium or zinc plated. Fasteners are applicable for use with fiber-glass blanket insulation up to 4" thick. KirbyRib II wall side laps are stitched with self-drilling carbon steel screws, No. 14 x 7/8" Type A or AB, cadmium or zinc plated. Fasteners are normally color coordinated with a premium coating system that protects against corrosion and weathering.

KirbyRib II roof panels are attached to secondary framing members by 12 x 1 ¼" self-drilling carbon steel screws with a molded zinc alloy or capped stainless steel cupped hex washer head. Roof fasteners shall be assembled with an EPDM washer.

KirbyRib II roof side laps are stitched with No. 14 x 7/8", Type "AB" self drilling carbon steel screws with a molded zinc alloy or capped stainless steel cupped hex washer head. Roof fasteners shall be assembled with an EPDM washer.

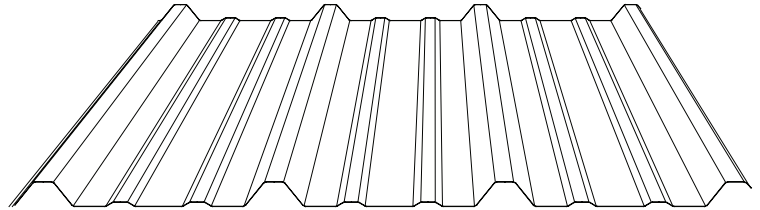

KirbyRib II panel roof side laps, end laps, roof flashing laps, ridges and eaves are sealed with tape mastic.

## TECHNICAL DATA

The KirbyRib II panel has received a Class 90 Wind Uplift rating by Underwriters Laboratories Inc. when tested in accordance with test procedure UL 580. This panel has also been tested in accordance with Air Infiltration ASTM E283 and Water Penetration ASTM E331. This panel has received a Class A fire rating when tested in accordance with test procedure ASTM E108.

## INSTALLATION

Installation should be performed in accordance with Kirby Building Systems' manuals and building erection drawings, and should be done by a qualified installer using proper tools and equipment. Systems are installed by Kirby Building Systems' Authorized Builders.

## WARRANTY

35 & 25 year paint finish warranties are available.

## MAINTENANCE

Only normal routine maintenance is required over the life of the panels.

## PRODUCT NOTES

Descriptions and specifications contained herein were in effect at the time this publication was approved for printing. In a continuing effort to refine and improve products, Kirby Building Systems reserves the right to discontinue products at any time or change specifications and/or designs without incurring obligation.

**Engineering Properties of Kirby Building Systems' KirbyRib II Panel**

Designated Gauge of Steel	Steel Yield (KSI)	Base Metal Thick. (In)	Total Thick (In) Thick. (In)	Panel Weight (Lbs/Ft <sup>2</sup> )	Top In Compression			Bottom In Compression			Fb (Ksi)
					Ix (In <sup>4</sup> /Ft)	Sx (In <sup>3</sup> /Ft)	Ma (K-IN)	Ix (In <sup>4</sup> /Ft)	Sx (In <sup>3</sup> /Ft)	Ma (K-IN)	
29 Gauge	80	0.0137	0.0153	0.74	0.030	0.025	0.90	0.026	0.035	1.26	36
26 Gauge	80	0.0177	0.0193	0.94	0.043	0.037	1.33	0.035	0.046	1.66	36
24 Gauge	80	0.0225	0.0241	1.17	0.060	0.054	1.94	0.047	0.059	2.12	36
22 Gauge	50	0.0300	0.0316	1.53	0.083	0.085	2.55	0.070	0.081	2.43	30

Gauge of Panel	Number of Spans	Load Type	Maximum Total Uniform Load in PSF															
			L= 3'-0"		L= 3'-6"		L= 4'-0"		L= 4'-6"		L= 5'-0"		L= 6'-0"		L= 7'-0"		L= 7'-4"	
29 Ga.	1	POS	57	C	47	B+S	36	B+S	29	B+S	23	B+S	15	D	8	D	8	D
		NEG	-83	B+S	-63	B+S	-43	D	-30	D	-22	D	-13	D	-7	D	-7	D
	2	POS	54	C	46	C	40	C	36	C	31	B+S	22	B+S	15	B+S	16	B+S
		NEG	-49	P	-42	P	-35	B+S	-28	B+S	-23	B+S	-16	B+S	-11	B+S	-11	B+S
	3	POS	61	C	53	C	46	C	41	C	37	C	27	B+S	15	D	15	D
		NEG	-56	P	-48	P	-42	P	-35	B+S	-28	B+S	-20	B+S	-13	D	-13	D
	4	POS	59	C	51	C	44	C	39	C	35	C	26	B+S	16	D	16	D
		NEG	-54	P	-46	P	-40	P	-33	B+S	-37	B+S	-19	B+S	-13	B+S	-13	B+S
26 Ga.	1	POS	96	B+S	71	B+S	55	B+S	43	B+S	35	B+S	21	D	11	D	11	D
		NEG	-117	B+S	-86	D	-57	D	-40	D	-29	D	-17	D	-9	D	-10	D
	2	POS	87	C	75	C	66	C	53	B+S	44	B+S	30	B+S	20	B+S	21	B+S
		NEG	-64	P	-55	P	-48	P	-42	P	-35	B+S	-24	B+S	-16	B+S	-17	B+S
	3	POS	99	C	85	C	74	C	65	B+S	53	B+S	38	B+S	21	D	21	D
		NEG	-72	P	-62	P	-54	P	-48	P	-43	B+S	-30	B+S	-18	D	-18	D
	4	POS	96	C	82	C	72	C	61	B+S	50	B+S	35	B+S	23	D	23	D
		NEG	-70	P	-60	P	-52	P	-46	P	-41	B+S	-28	B+S	-19	D	-19	D
24 Ga.	1	POS	141	B+S	104	B+S	80	B+S	63	B+S	51	D	29	D	16	D	16	D
		NEG	-153	B+S	113	B+S	-77	D	-54	D	-39	D	-23	D	-13	D	-13	D
	2	POS	136	C	112	B+S	87	B+S	69	B+S	56	B+S	39	B+S	26	B+S	27	B+S
		NEG	-81	P	-69	P	-61	P	-54	P	-49	P	-36	B+S	-24	B+S	-24	B+S
	3	POS	155	C	133	C	107	B+S	87	B+S	69	B+S	48	B+S	30	D	30	D
		NEG	-92	P	-79	P	-69	P	-61	P	-55	P	-43	D	-24	D	-24	D
	4	POS	149	C	128	C	100	B+S	81	B+S	65	B+S	45	B+S	30	B+S	31	B+S
		NEG	-89	P	-76	P	-66	P	-59	P	-53	P	-42	B+S	-25	D	-26	D
22 Ga.	1	POS	186	B+S	137	B+S	105	B+S	83	B+S	68	B+S	40	D	22	D	22	D
		NEG	-177	B+S	-131	B+S	-100	B+S	-79	B+S	-59	D	-34	D	-19	D	-19	D
	2	POS	176	B+S	130	B+S	100	B+S	79	B+S	64	B+S	45	B+S	30	B+S	30	B+S
		NEG	-114	P	-98	P	-86	P	-76	P	-67	B+S	-47	B+S	-31	B+S	-31	B+S
	3	POS	217	B+S	161	B+S	124	B+S	98	B+S	80	B+S	56	B+S	37	B+S	38	B+S
		NEG	-130	P	-111	P	-98	P	-87	P	-78	P	-58	D	-35	D	-35	D
	4	POS	204	B+S	151	B+S	116	B+S	92	B+S	75	B+S	52	B+S	35	B+S	35	B+S
		NEG	-125	P	-107	P	-94	P	-83	P	-75	P	-55	B+S	-37	B+S	-37	B+S

1. The panels were checked for bending (B), shear (S), combined bending and shear (B+S), deflection (D), web crippling (C) and panel pullover (P). The controlling check is noted in the table. Deflection was limited to span/150.

2. Section properties have been calculated in accordance with the 2001 North American Specification for the Design of Cold-Formed Steel Structural Members.

3. Steel panels are either aluminum zinc alloy or G-90 coated. The base metal thickness was used in determining section properties.

4. Positive load (POS) is applied inward toward the panel supports and is applied to the outer surface of the panel cross-section. Negative load (NEG) is in the opposite direction.